




Cantidades de Rydlyme Marine para limpiar el lado del agua de los intercambiadores de calor con caparazón y tubo.

	4'	5'	6'	8'	10'	12'	16'	18'	20'	24'	30'	36'	40'
4"	1	1	1	2	2	2	3	3	3	4	5	6	6
5"	1	1	2	2	3	3	4	5	5	6	8	10	10
6"	2	2	3	3	4	5	6	7	7	9	12	15	16
8"	3	3	4	5	7	8	10	12	13	16	20	25	30
10"	4	5	6	8	10	12	16	18	20	25	30	40	45
12"	6	7	9	12	15	18	24	27	30	35	45	55	60
16"	10	13	16	21	25	30	42	50	55	60	80	95	110
20"	16	20	25	32	40	50	65	75	80	100	120	150	160
24"	25	30	35	50	60	70	95	110	120	140	180	220	240
30"	35	45	55	75	90	110	150	165	180	220	280	330	360
36"	55	65	80	110	130	160	220	250	275	330	400	495	550
40"	65	80	100	130	160	200	260	300	330	400	500	600	660
44"	80	100	120	160	200	240	320	360	400	475	600	720	800
48"	100	120	140	190	240	280	380	425	480	560	710	850	950
50"	105	130	160	210	260	315	415	470	520	625	780	935	1040
54"	120	150	180	240	300	360	480	540	600	715	895	1075	1195
60"	150	185	220	295	370	445	590	665	740	885	1105	1325	1475

Galones de Rydlyme Marine

- = 1 hora
- = 2 horas
- = 3 horas
- = 4 horas
- = 5 horas
- = 6 horas
- = 7 horas
- = 8 horas

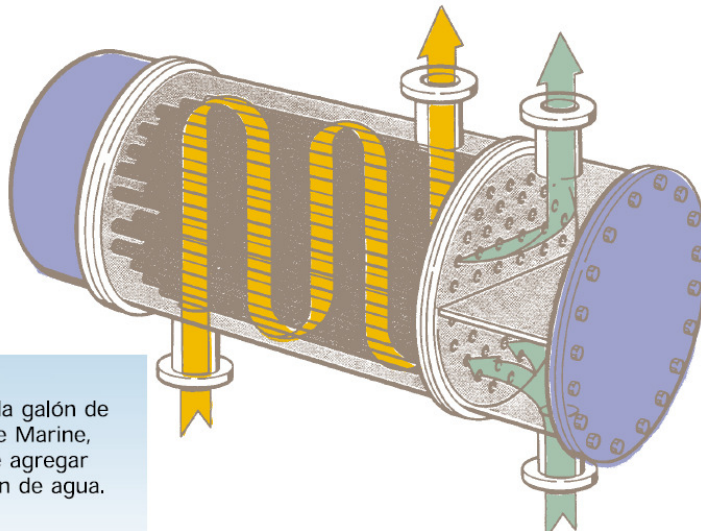

Por cada galón de Rydlyme Marine, se debe agregar un galón de agua.

Tome nota:
El agua enfriante puede ser del lado del tubo o del lado del caparazón. Rydlyme Marine debe bombearse desde la base pasando por todo hasta la parte de arriba.